TYPE · LV SHEARER CABLE · CHAIN · FIBRE OPTIC | 0.6/1 kV | 1 Variant

PROTOMONT (V) LWL Equivalent

FC-PMT-V-LWL NSSHCGEÖU 0,6/1 kV

Low voltage coal-cutter cable for chain operation with concentric earth and a central fibre-optic element — power, control and data for automated longwall shearers.

Document No. **FC-TDS-PMVLF-2026-5F7D** Revision **0** Issue date **12 October 2026**

Language **English (AU)**

01 Application & Product Overview

FC-PMT-V-LWL NSSHCGEÖU 0.6/1 kV combines the chain-operation PROTOMONT (V) power design with a central fibre-optic element for high-rate machine control, automation and condition monitoring.

The fibre-optic element sits in the protected centre of the core assembly, surrounded by the three screened main cores and three double-concentric control/PE elements. The steel/copper spinning between the sheaths gives reinforcement and anti-torsion protection for continuous chain operation.

Typical applications

- Automated longwall shearers — control and condition-monitoring data
- Video and high-rate data links from the shearer
- Cable handlers on 1,000 V shearer supplies
- Underground coal mines with firedamp / coal-dust explosion risk (with approved couplers)
- EMI-immune data alongside power in one cable

1 variant
3×95 mm² + 12 fibres

0.6/1 kV
Rated voltage, 3 kV test

12 fibres
G50/125 standard, G.652.D option

15 N/mm²
Max. tensile load on conductors

Cross-reference

REFERENCE TYPE

PROTOMONT (V) NSSHCGEÖU LWL 0,6/1 kV


⇄

FEICHUN EQUIVALENT

FC-PMT-V-LWL NSSHCGEÖU 0,6/1 kV

Equivalent to PROTOMONT (V) NSSHCGEÖU LWL 0,6/1 kV. Further sizes and fibre counts can be designed to order.

02 Construction

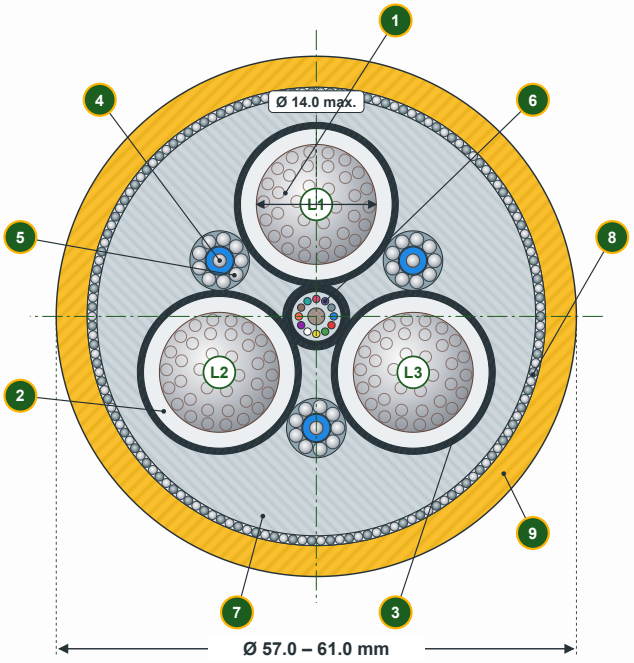

FEICHUN · SECTION A–A · 0.6/1 kV

FC-PMT-V-LWL NSSHCGEÖU

Doc. No. FC-TDS-PMVLF-2026-5F7D
Ref. 3×95 mm²
Rev. 0 · 2026-10-12 · 1st-angle · NTS

Drawing representative of the reference size; other sizes scale proportionally.

Pos.	Element	Material
1	Conductor	Tinned annealed copper, very finely stranded, class FS (DIN VDE 0295) / class 5 (IEC 60228)
2	Insulation	EPR rubber compound type 3GI3 (DIN VDE 0207-20); main cores black, grey and brown
3	Core screen	Cold-strippable semi-conductive elastomer layer over each main core
4	Control core (ST)	Tinned copper 1.5 mm², EPR 3GI3 insulation, blue
5	Concentric PE conductor (KON)	Tinned copper wires concentric over the control core; protective earth split into three
6	Fibre-optic element (centre)	12 fibres in a gel-filled loose tube, aramid strength members, elastomer element sheath
7	Inner sheath	Vulcanised EPR-based rubber compound GM1b (DIN VDE 0207-21)

Pos.	Element	Material
8	Reinforcement / anti-torsion	Closed-lay spinning of galvanised steel and tinned copper wires, vulcanised between inner and outer sheath
9	Outer sheath	Heavy-duty polychloroprene (PCP) compound 5GM5 (DIN VDE 0207-21), abrasion-, notch- and tear-resistant, flame-retardant, oil-resistant, yellow

Drawing: 3×95 mm² reference size.

Construction details

Element	Description
Conductor	Very finely stranded tinned annealed copper, class 5 (class FS) to DIN VDE 0295 / IEC 60228
Power core insulation	EPR rubber compound type 3GI3 to DIN VDE 0207-20
Core screen	Cold-strippable semi-conductive elastomer layer over each power core
Fibre-optic element (centre)	Central LWL element in the inner interstice: 12 fibres in a gel-filled loose tube, aramid-yarn strength members, PUR/elastomer element sheath (black), protected by the surrounding power cores
Power cores	Three main cores, colours black, grey and brown
Control / earth elements	Three double-concentric elements in the outer interstices: 1.5 mm² tinned copper control core (3GI3, blue) with protective earth split into three concentric tinned copper wire layers (50/3 KON)
Lay-up	Lay length approx. 6 × core assembly diameter
Inner sheath	Vulcanised EPR-based rubber compound GM1b to DIN VDE 0207-21
Reinforcement / anti-torsion braid	Closed-lay spinning of combined galvanised steel and tinned copper wires, vulcanised between inner and outer sheath
Outer sheath	Polychloroprene (PCP) compound 5GM5 to DIN VDE 0207-21, yellow, flame-retardant and oil-resistant

03 Electrical, Thermal & Mechanical Data

Electrical parameters

Parameter	Value
Rated voltage U_0/U (Um)	0.6/1 (1.2) kV AC; 0.9/1.8 kV DC
Test voltage	3 kV AC (power cores); 2 kV AC (control cores)
Current ratings	Per DIN VDE 0298-4, 30 °C ambient, cable fully unreeled / in chain

Thermal & mechanical parameters

Parameter	Value
Max. conductor temperature	+90 °C
Max. short-circuit temperature	+250 °C (≤ 5 s)
Ambient temperature, fixed installation	−40 °C to +80 °C
Ambient temperature, fully flexing operation	−20 °C to +60 °C
Max. tensile load on conductors	15 N/mm² (permanent, related to total phase cross-section)
Min. bending radius in cable chain	2.3 × D at tensile load ≤ 5 N/mm² (DIN VDE 0298-3); 5 × D at higher tensile load
Min. distance between S-type direction changes	20 × D
Max. torsional stress	±25 °/m
Flame retardance	EN 60332-1-2 / IEC 60332-1-2
Oil resistance	EN 60811-404 / IEC 60811-404
UV, ozone and weather resistance	Resistant (5GM5 PCP outer sheath)

04 Optical Fibre Data

Characteristic	Value
Fibre type	G50/125 multimode (OM2) standard; G.652.D single-mode on request
Max. number of fibres	12
Element	Central gel-filled loose tube with aramid strength members and elastomer/PUR element sheath, placed in the inner interstice of the three power cores
Attenuation (dB/km) — 850 nm (G50/125)	≤ 3.0
Attenuation (dB/km) — 1300 nm (G50/125)	≤ 1.0
Attenuation (dB/km) — 1310 nm (G.652.D)	≤ 0.40
Attenuation (dB/km) — 1550 nm (G.652.D)	≤ 0.30
Bandwidth	G50/125: ≥ 500 MHz·km at 850 nm and 1300 nm

Fibre type and count per variant as stated in the type designation; other fibre types and counts on request.

05 Dimensions, Weights & Ratings — 0.6/1 kV (1 variant)

Type designation cores × mm²	FeiChun part no.	Conductor Ø max. mm	Outer diameter min. mm	Outer diameter max. mm	Min. bending radius mm	Weight approx. kg/km	Max. tensile force N	R_{20} max. Ω/km	Current rating A	Short-circuit current kA (1 s)
3×95+3×(1.5STKON+50/3KON)+12 OFE	FC-PMVLF-001	14.0	57.0	61.0	140	7,150	4,275	0.210	301	13.58

Current rating: DIN VDE 0298-4 values for flexible rubber cables at 30 °C ambient — apply the factors below for other ambient temperatures, grouping and multi-layer laying. Bending radius: 2.3 × D in the cable protection chain at ≤ 5 N/mm² tensile load. Tensile force: 15 N/mm² × total phase cross-section. Further sizes and special designs are manufactured to order.

Ambient temperature factors (90 °C conductor)

°C	20	25	30	35	40	45	50
Factor	1.08	1.04	1.00	0.96	0.91	0.87	0.82

Short-circuit rating

Permissible short-circuit current for 1 s: $I_k = 0.143$ kA/mm² × phase cross-section (EPR, 90 °C → 250 °C, tinned copper). For other durations t: $I_{k,t} = I_{k,1s} / \sqrt{t}$ (0.1 s ≤ t ≤ 5 s).

06 Standards & Tests

Standard	Scope
DIN VDE 0250-812	Basis of design — flexible mining cables, low voltage
DIN VDE 0295 / IEC 60228	Conductors, class FS / 5 — class 5, tinned
DIN VDE 0207-20	Insulating compound 3GI3 — 3GI3
DIN VDE 0207-21	Sheathing compounds — GM1b, 5GM5
DIN VDE 0298-3	Use of cables — bending radii, tensile load
DIN VDE 0298-4	Current-carrying capacity
EN 60332-1-2 / IEC 60332-1-2	Flame propagation, single cable
EN 60811-404 / IEC 60811-404	Oil resistance of sheath
DIN VDE 0118	Electrical installations in underground mining
IEC 60793-2-10 / IEC 60793-2-50	Optical fibres — fibres
IEC 60794-1-2	Optical cables — test methods — FO element test methods

Routine & type tests

- AC voltage test 3 kV on every drum (main cores); 2 kV on control cores
- Conductor resistance, dimensional and continuity checks of PE, control and monitoring conductors
- OTDR attenuation measurement of every fibre, report supplied with the drum
- Insulation resistance and screen / semi-conductive layer resistance
- Bending, torsion and tensile tests in a cable protection chain (type test)
- Flame retardance (IEC 60332-1-2) and oil resistance (IEC 60811-404) of the outer sheath

Test documentation: each delivery is accompanied by a FeiChun in-house laboratory inspection certificate. Third-party witnessed testing can be arranged at the buyer's cost.

07 Installation, Marking & Delivery

Installation notes

- Guide the cable in the cable protection chain (cable handler) — the chain takes the tensile forces; minimum bending radius 2.3 × D at ≤ 5 N/mm² tensile load.
- Keep at least 20 × D between S-type direction changes and keep torsion within the stated limit.
- Do not exceed the permanent tensile load of 15 N/mm² on the main conductors, including start-up and braking peaks.
- Unwind tangentially from the delivery drum — never pull off over the flange; lay out and relax the cable before fitting it into the chain.
- Connect all three PE parts at both ends; connect control and monitoring conductors to the earth-fault / insulation monitoring relay of the shearer supply.
- Use flameproof (Ex d) or increased-safety plugs and couplers suited to the cable diameter and approved for the mine.
- Fibre-optic versions: factory pre-assembly of FO connectors or splice enclosures is recommended — please supply connection details with the order.

Sheath marking

```
FEICHUN FC-PMT-V-LWL NSSHCGEÖU
3×95+3×(1.5STKON+50/3KON)+12 OFE 0,6/1
kV [year] [serial no.] [metre mark]
```

Packing & delivery

Item	Standard
Drum	Steel or fumigated wooden drums, ends sealed with heat-shrink caps
Lengths	To order, single continuous length (no joints)
Production lead time	2–3 weeks after technical confirmation
Warranty	Min. 3 years against manufacturing defects
Drum label	Type, size, length, gross/net weight, batch no., drum no.

08 Certifications & Quality

CE — LVD 2014/35/EU
Attestation No. M.2025.206.C116598 · EN 50525-1:2011+A1:2022 · UDEM International Certification · valid to 01.04.2030

EAC — TR CU 004/2011
Certificate No. ЕАЭС KG417/052.CN.02.15390 · GOST 31996-2012, GOST 31565-2012 · valid 24.10.2025–23.10.2030

UKCA — Verification
No. ICR/VC/HS2508110 · BS EN 50525-1:2011+A1:2022 · ICR Polska · valid to 17.08.2030

FeiChun also holds ATEX (Directive 2014/34/EU) documentation verification and IECEx / VDE related approvals for designated product families. Mine-specific approvals are arranged with the end user or local distributor where required. Certificate copies are available on request.

09 Trademark Notice & Intellectual Property

PROTOMONT® and the type designation PROTOMONT (V) NSSHCGEÖU LWL 0,6/1 kV are cited to identify the reference product of Prysmian Group, the trademark owner. They are used solely for technical cross-referencing; FeiChun Cables has no affiliation with, and is not endorsed by, the trademark owner. FC-PMT-V-LWL is a FeiChun product designed to equivalent functional performance.

© 2026 Anhui FeiChun Special Cable Co., Ltd. — All rights reserved. This document, including its drawings, tables and layout, is the intellectual property of FeiChun and is protected under the Copyright Law and the Anti-Unfair Competition Law of the People's Republic of China and the Copyright Act 1968 (Cth) of Australia. Reproduction, redistribution or modification in whole or in part without written consent is prohibited. Technical data are subject to change without notice as part of continuous product development.

Technical & Sales Contact

Anhui FeiChun Special Cable Co., Ltd.
International Business Department
No. 1 Park, Private Science & Technology Park, Hefei National ETDZ, Hefei, Anhui, China
Technical: Tech@feichuncables.com
Mining & heavy industry: mining@feichuncables.com
Zihao Yang, Global Sales Manager:
zihao.yang@feichuncables.com
WhatsApp: +86 138 5512 3218
Web: www.feichuncables.com

Document Control

Doc. No. FC-TDS-PMVLF-2026-5F7D
Revision 0 — first issue
Date 12 October 2026
Product FC-PMT-V-LWL NSSHCGEÖU 0,6/1 kV

Prepared — Technical Dept.	Checked — QA	Approved — Intl. Business